



USP: RECLOSER @ 11J505
 USP:
 USP:
 USP:
 USP:




Safety Reminders / Adverse Conditions
 ?:
 ?:
 ?:
 ?:



Work Zone General Comments: **SINGLE LANE ENCLOSURE**

REMEMBER: Work zone area conditions may have changed for this job! Everyone is responsible for verifying the above safety information is correct prior to any work being performed each day.

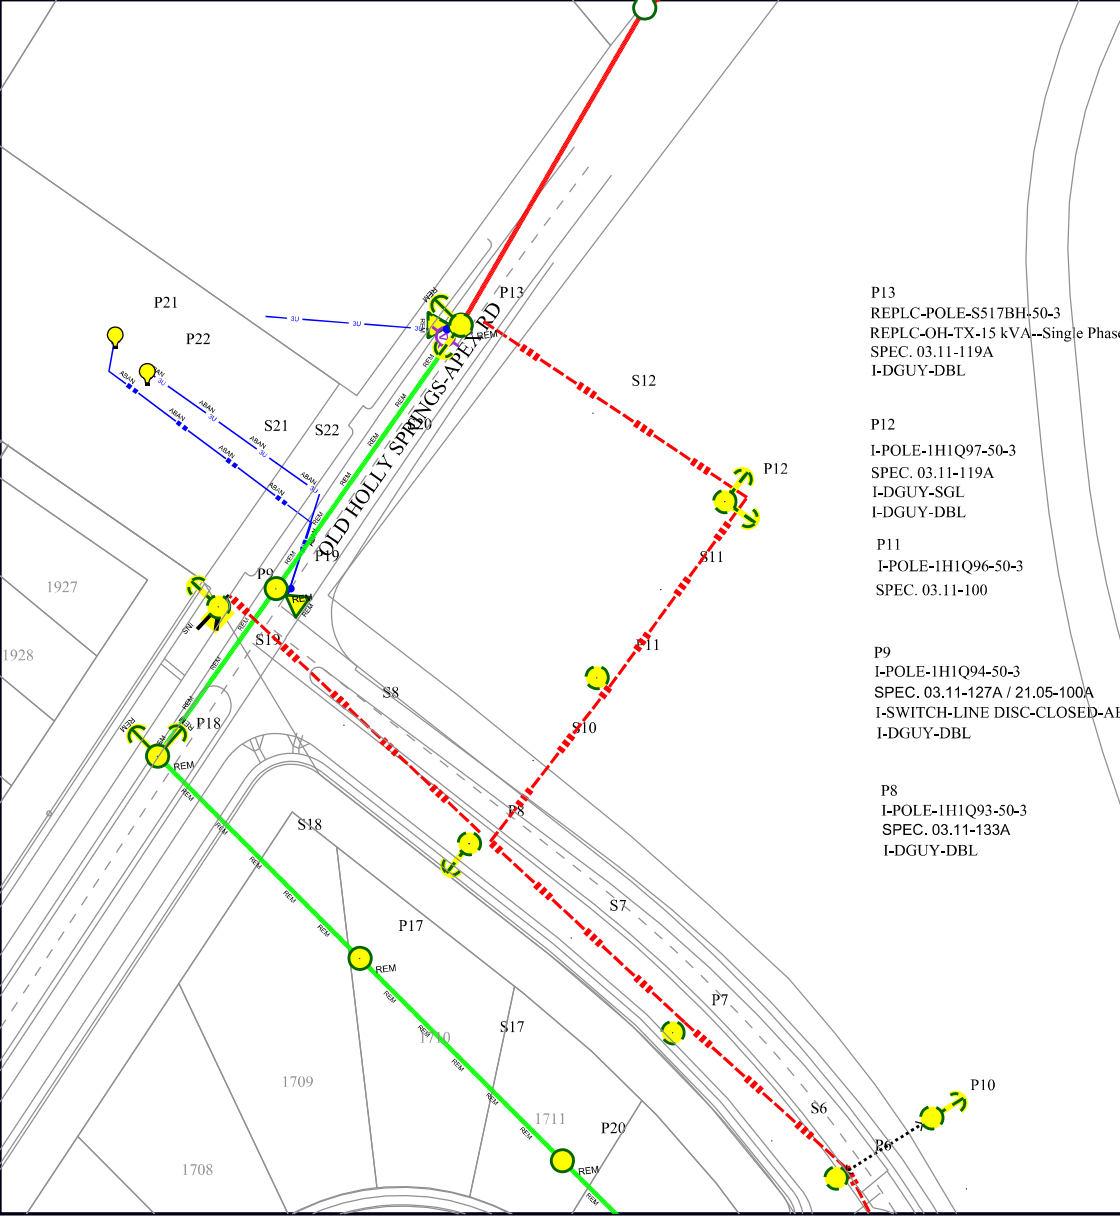

SCOPE:
 PRIMARY FEEDER RELOCATION. INSTALL NEW PRIMARY LINE PER THIS MAP W/ 50C3 POLES AND 477 PRI/ 1/0 NEU. ALL POLES AND GUYS TO BE INSTALL PER NOTED SPEC.



P13
 REPLC-POLE-S517BH-50-3
 REPLC-OH-TX-15 kVA--Single Phase-B
 SPEC. 03.11-119A
 I-DGUY-DBL

P12
 I-POLE-1H1Q97-50-3
 SPEC. 03.11-119A
 I-DGUY-SGL
 I-DGUY-DBL

P11
 I-POLE-1H1Q96-50-3
 SPEC. 03.11-100

P9
 I-POLE-1H1Q94-50-3
 SPEC. 03.11-127A / 21.05-100A
 I-SWITCH-LINE DISC-CLOSED-ABC
 I-DGUY-DBL

P8
 I-POLE-1H1Q93-50-3
 SPEC. 03.11-133A
 I-DGUY-DBL

P6
 I-POLE-1H1Q91-50-3
 SPEC. 03.11-112A
 I-SPGUY-DBL-75FT
 P10
 I-POLE-1H1Q95-30-6
 SPAN GUY POLE
 I-DGUY-DBL

P7
 I-POLE-1H1Q92-50-3
 SPEC. 03.11-100

P14 - P20
 R-POLE-50-3
 R-OH-PRIMARY-477 AL-ABC

Work Order Number	2883349
Customer/Contact	
Contact Phone	
Job Site Address	Old Holly Spring Rd
City	APEX
County	WAKE
State, Zip	NC, 27502
Designer	Reubin Kennedy
Designer Phone	919-481-6137

Circuit ID	T4530B60
Primary Voltage	23KV
Permit Required	Yes ___ No ___
Permit Type/No.	
Permit Type/No. 2	
Permit Type/No. 3	
Permit Type/No. 4	